

Figure 6-10. 1994 - 2005 Sitewide Average 0-6 Inch Soil Lead vs. First-test Blood Lead Level

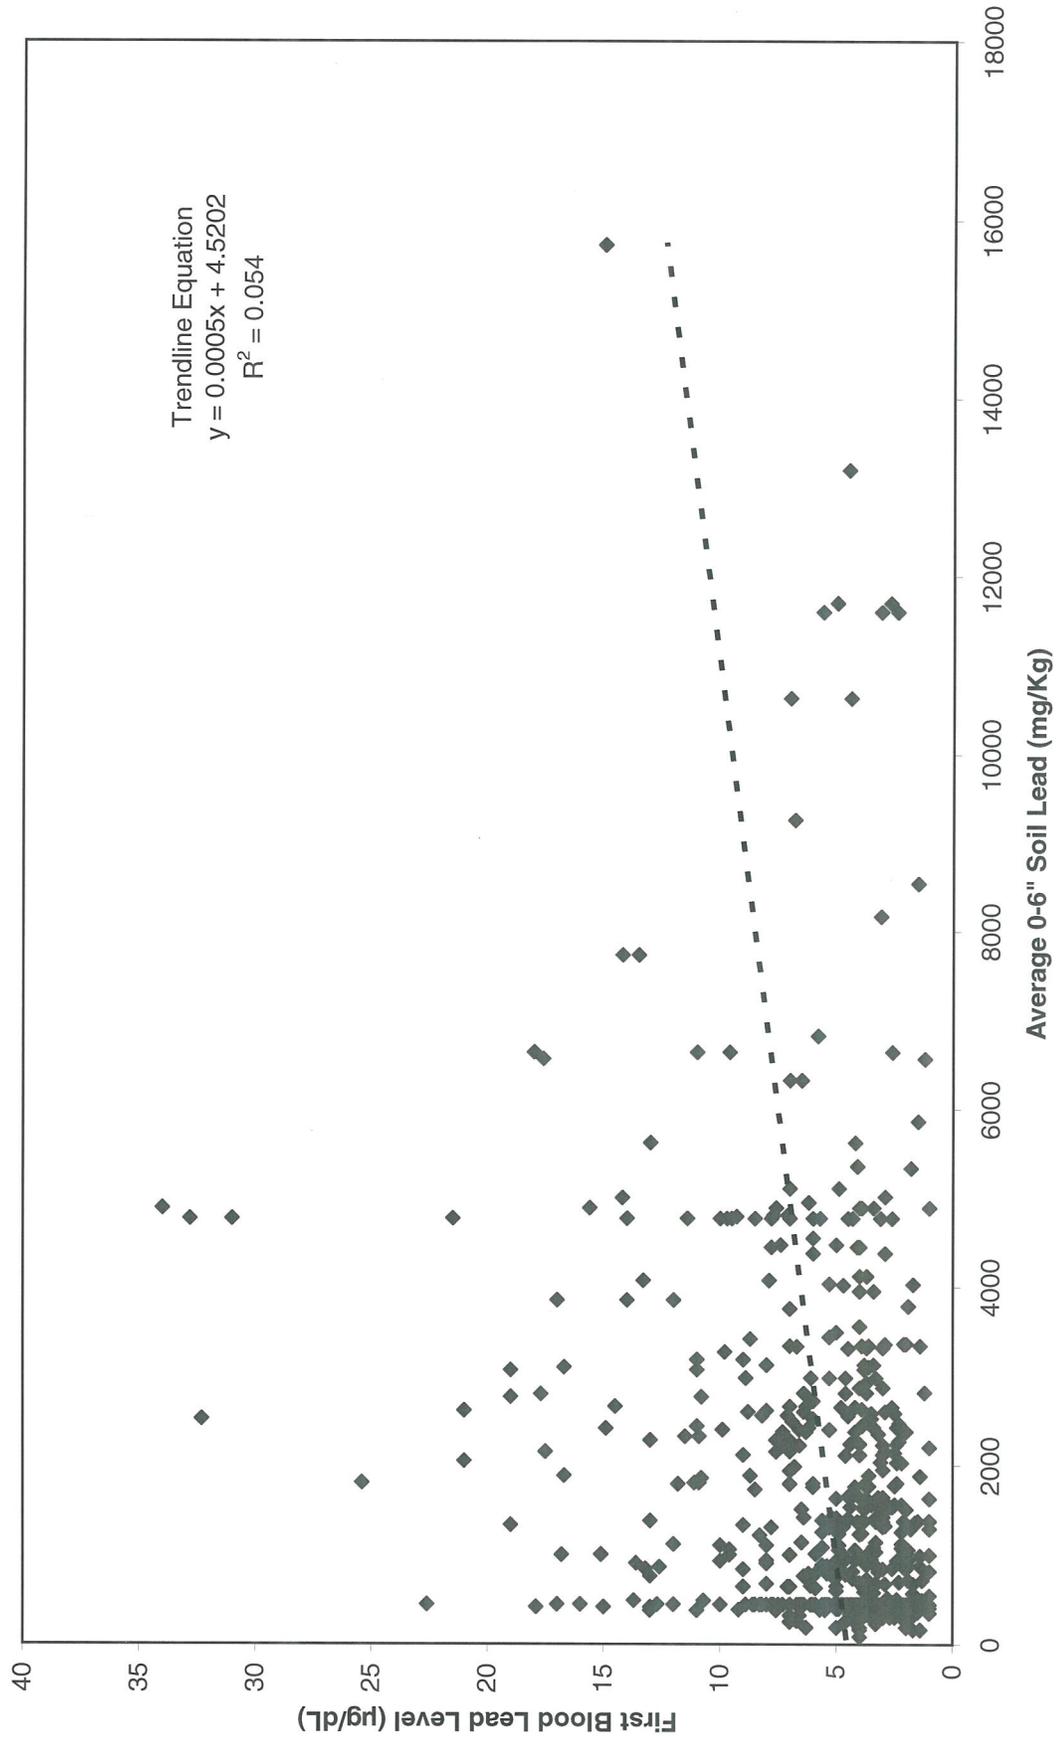


Figure 6-10a. 1994-2005 - Statistical Unit 1 - Average 0-6 Inch Soil Lead vs. First-test Blood Lead Level

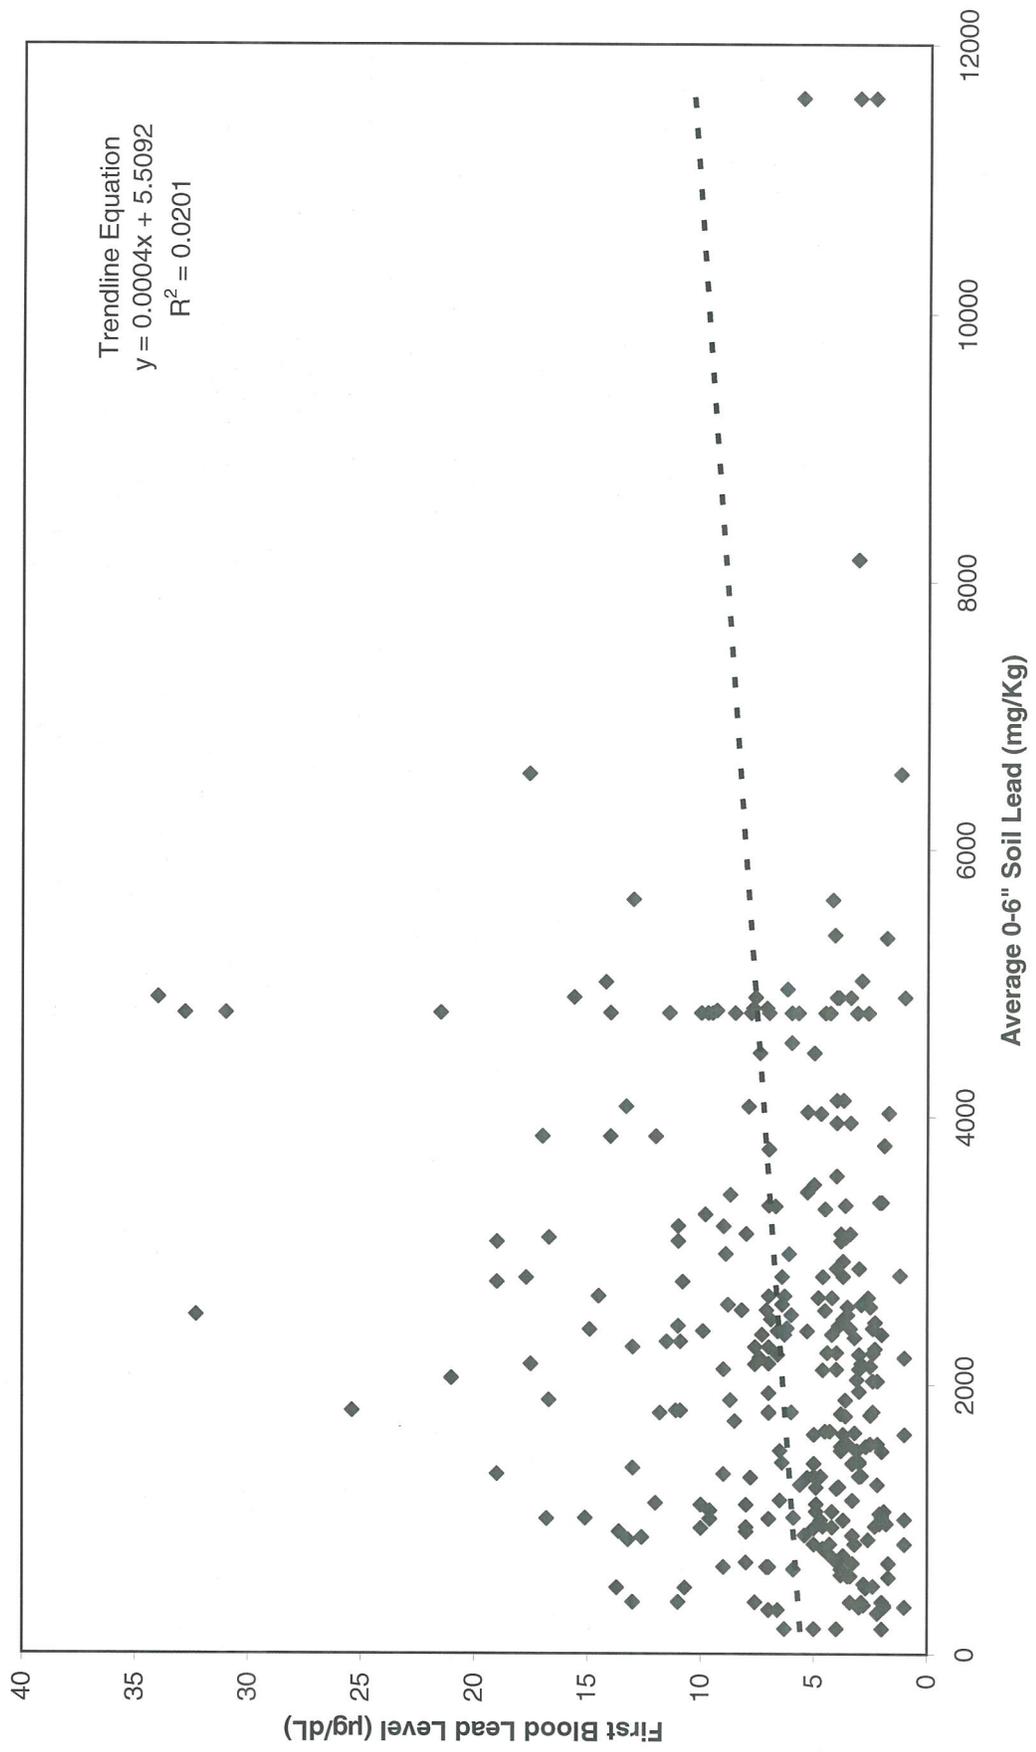


Figure 6-11. 1994 - 2005 Sitewide Average 0-2 Inch Soil Lead vs. First-test Blood Lead Level

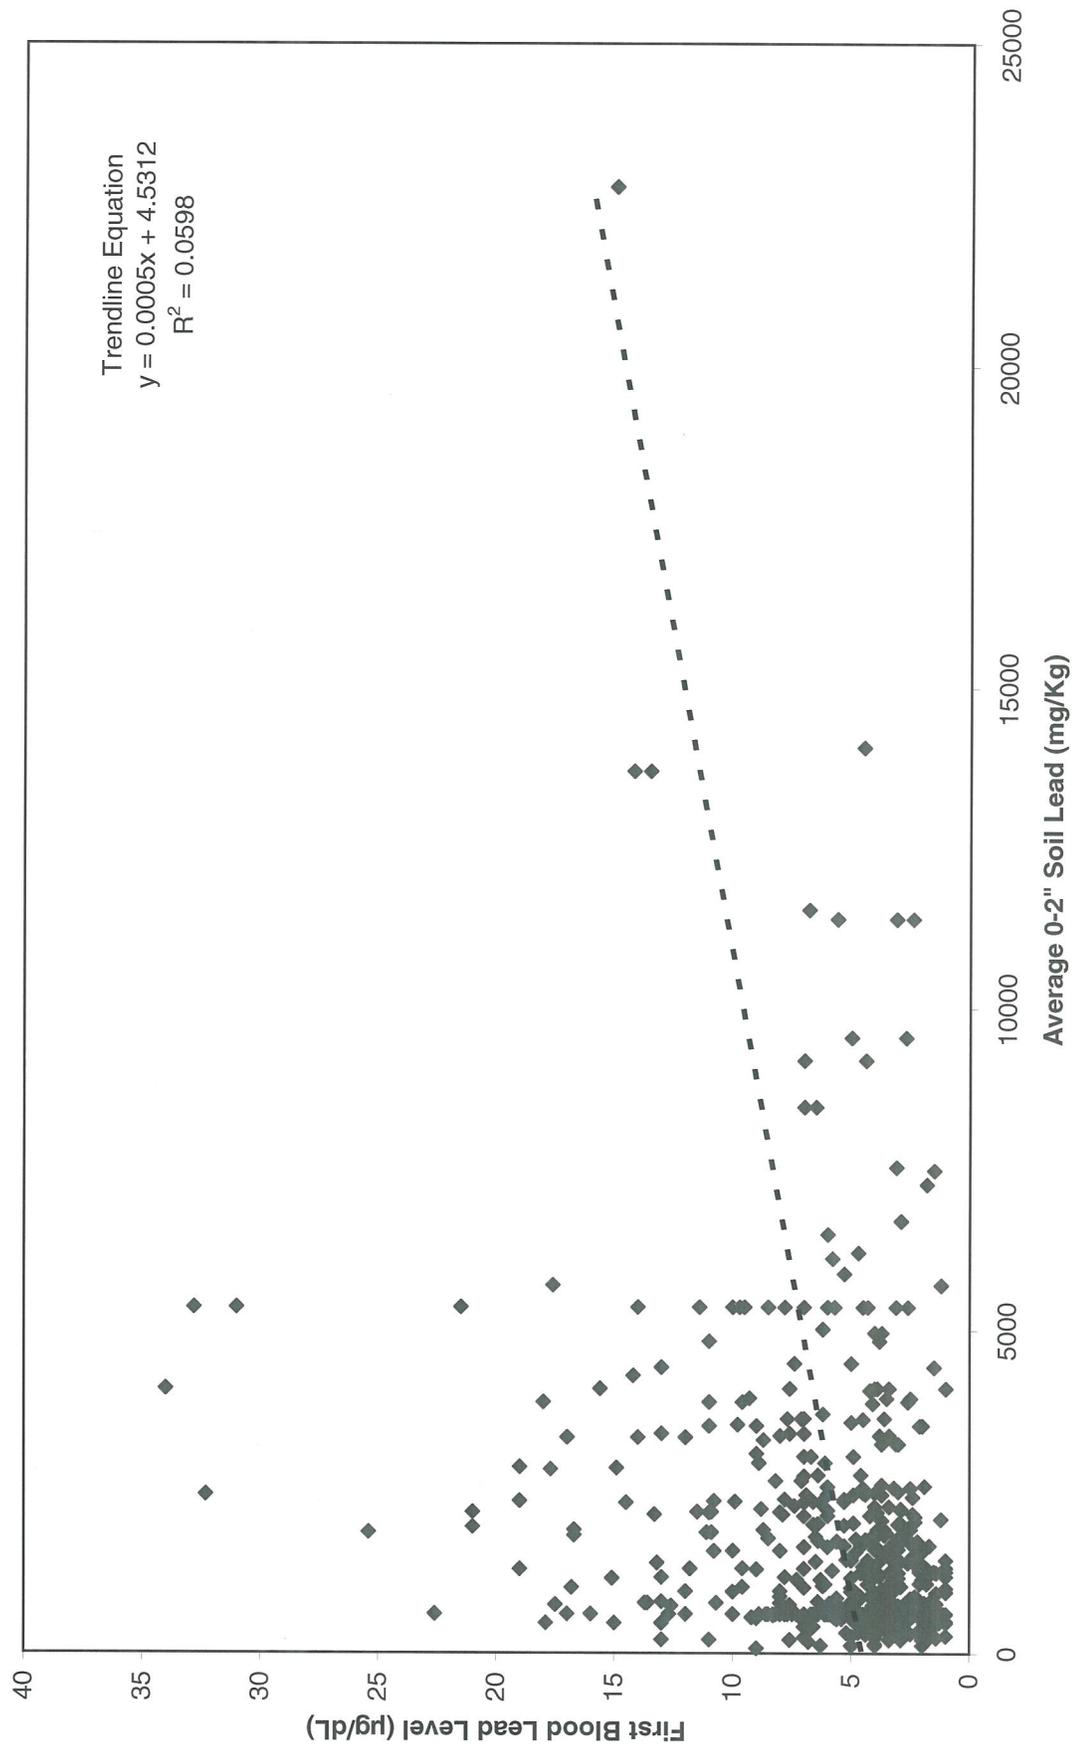


Figure 6-11a. 1994-2005 - Statistical Unit 1 - Average 0-2 Inch Soil Lead vs. First-test Blood Lead Level

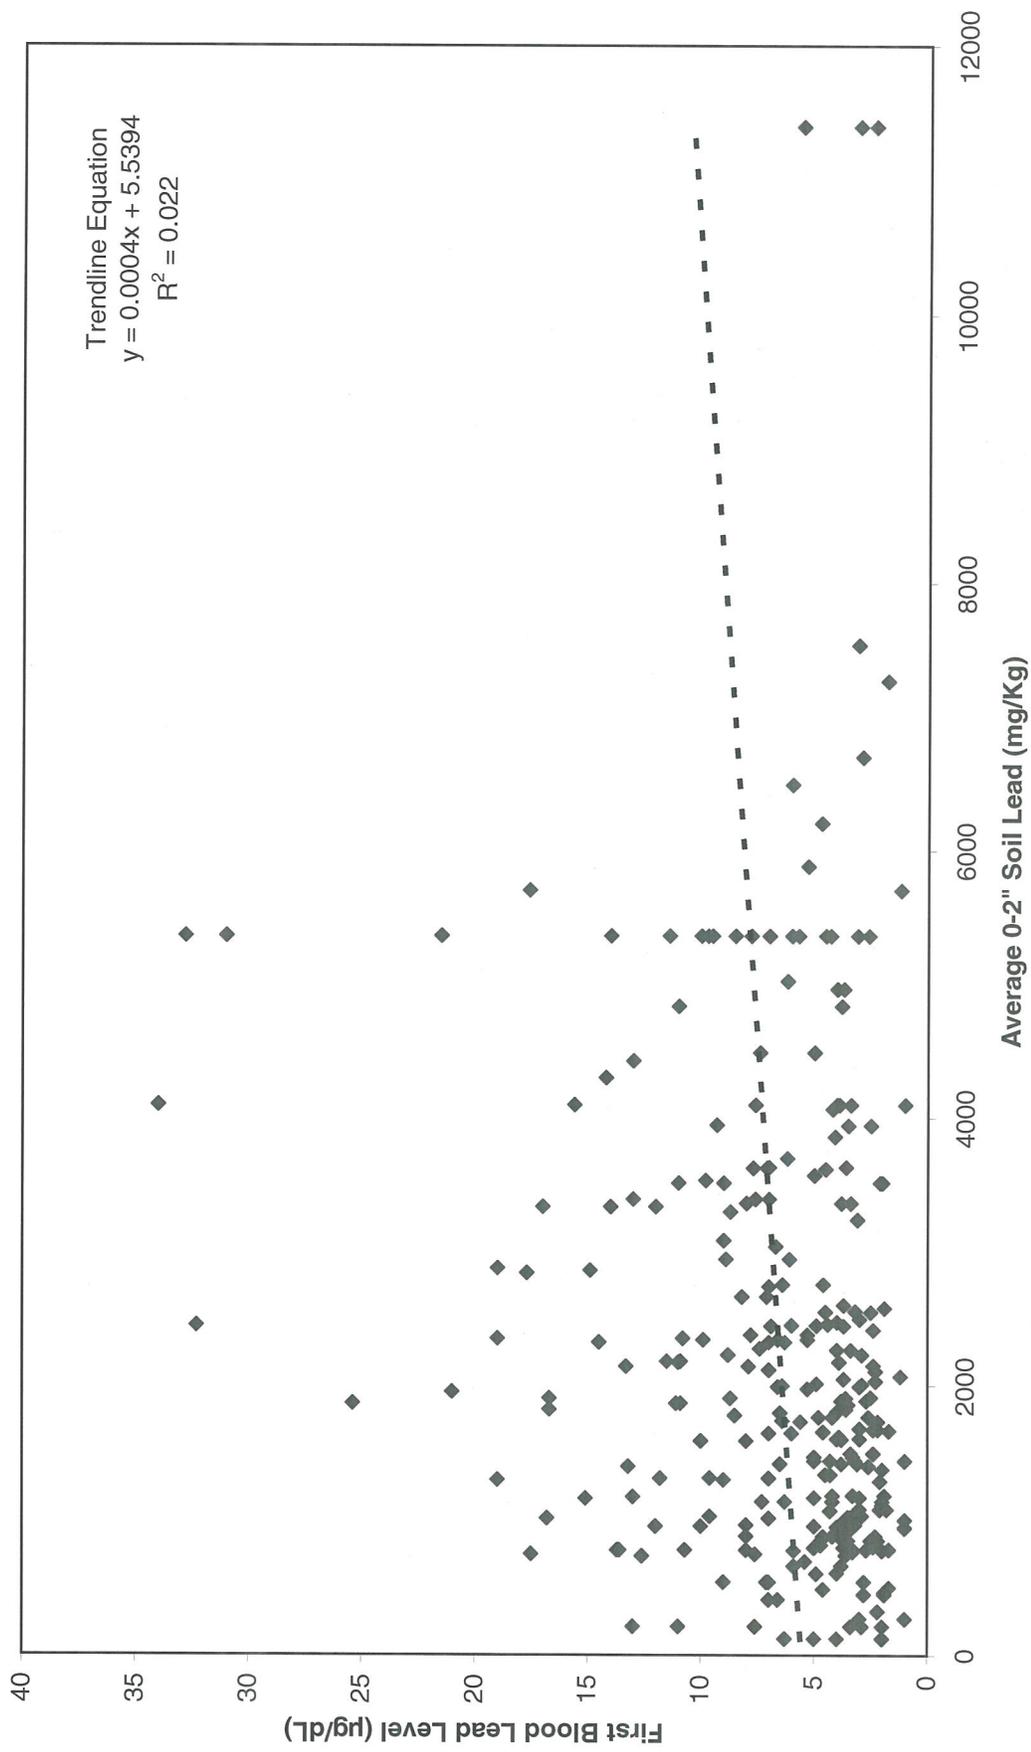


Figure 6-12. 1994-2005 - Sitewide - Maximum Paint Lead Concentration (poor condition) vs. First-test Blood Lead Level

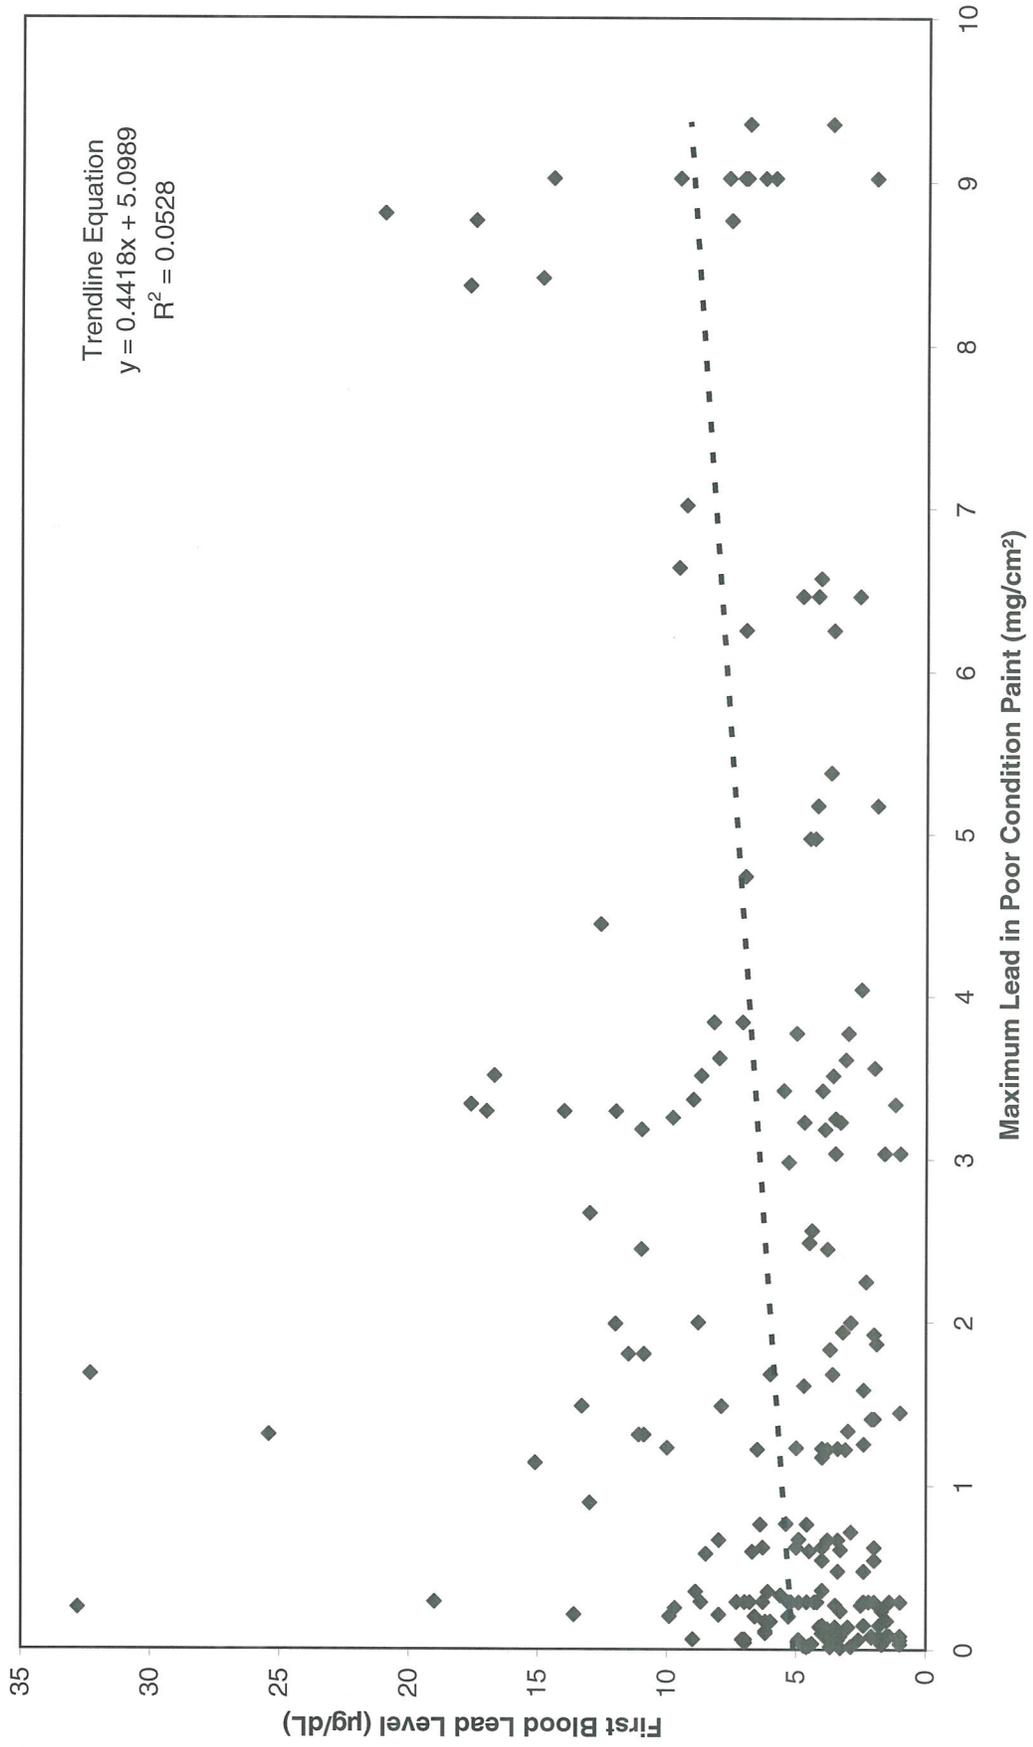


Figure 6-12a. 1994-2005 - Statistical Unit 1 - Maximum Paint Lead Concentration (poor condition) vs. First-test Blood Lead Level

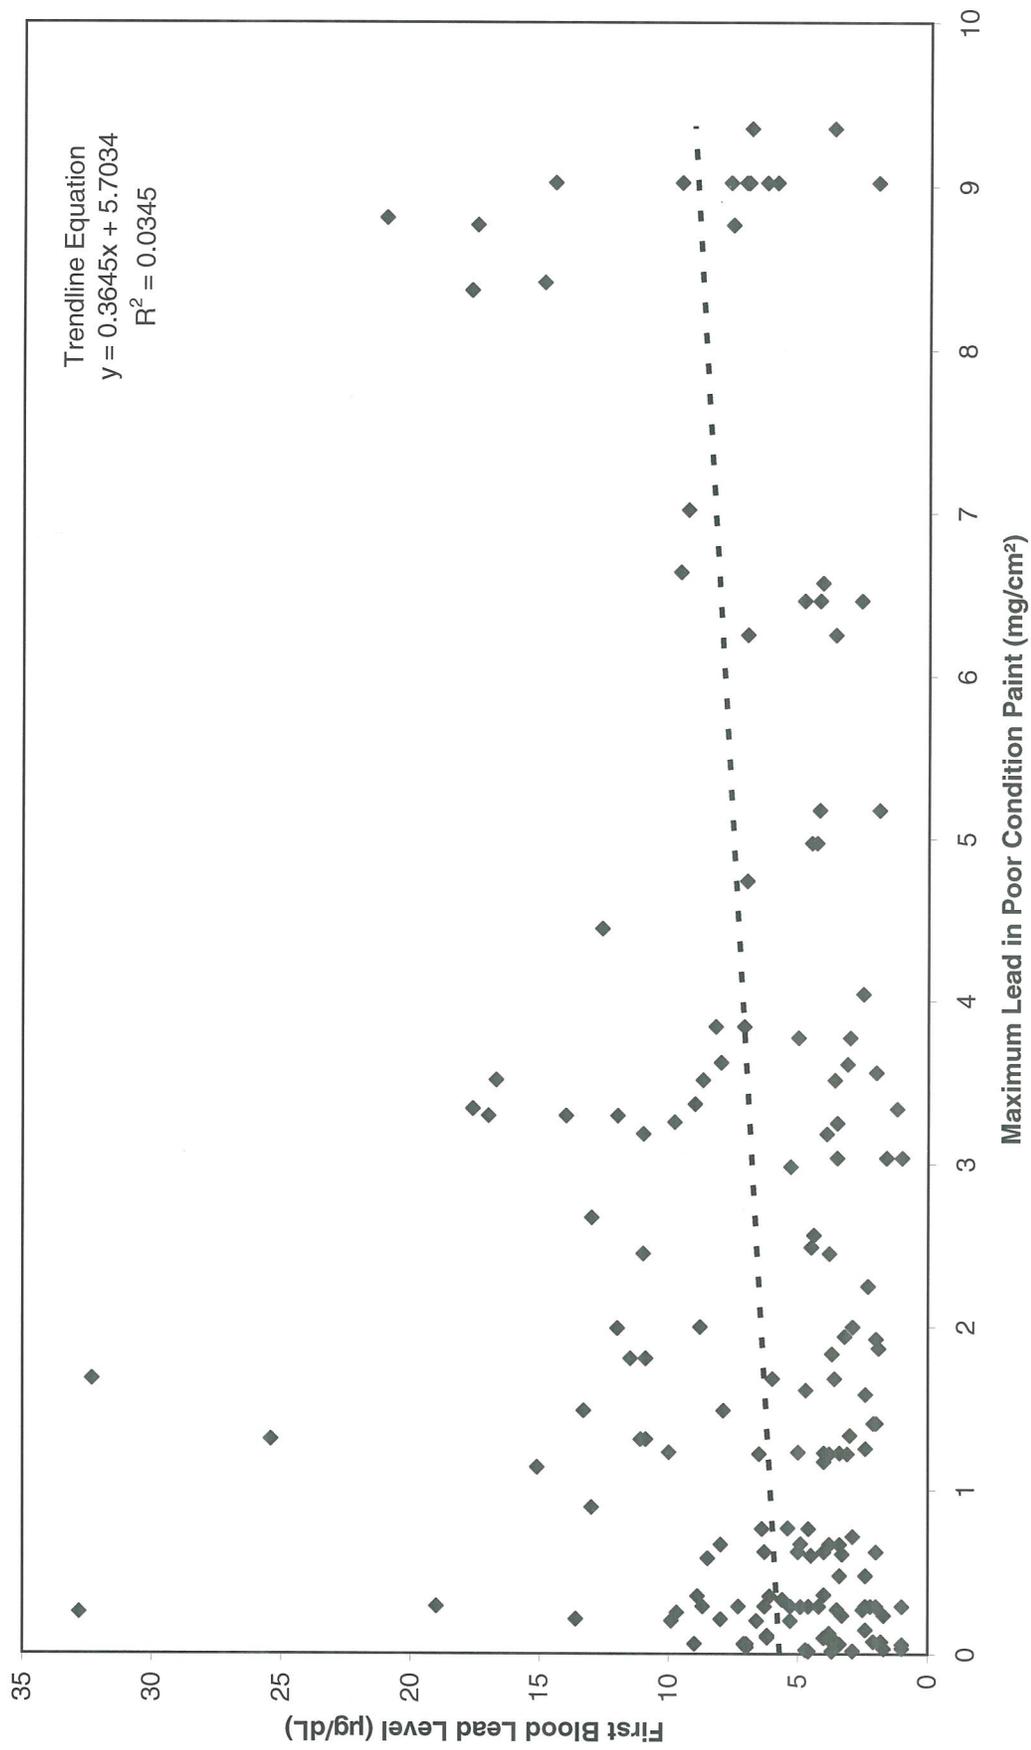


Figure 6-13. 1994-2005 - Sitewide - Average Main Living Area Dust Lead vs. First-test Blood Lead Level

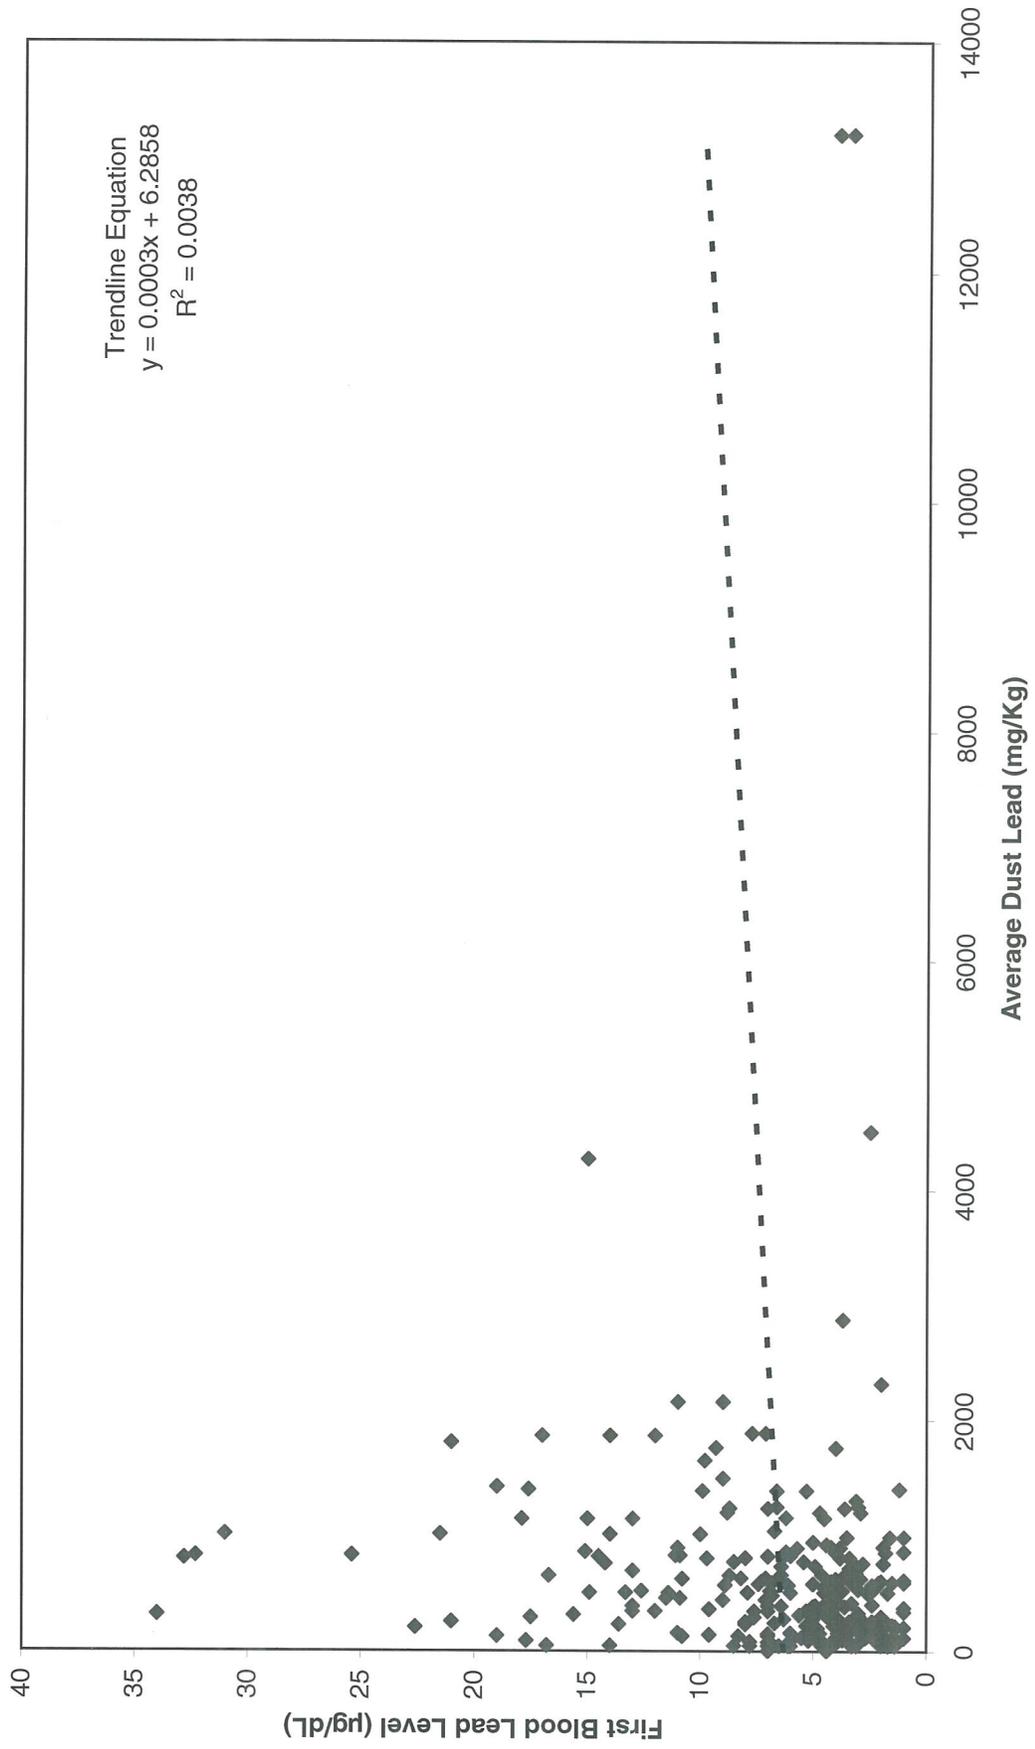


Figure 6-13a. 1994-2005 - Statistical Unit 1 - Average Main Living Area Dust Lead vs. First-test Blood Lead Level

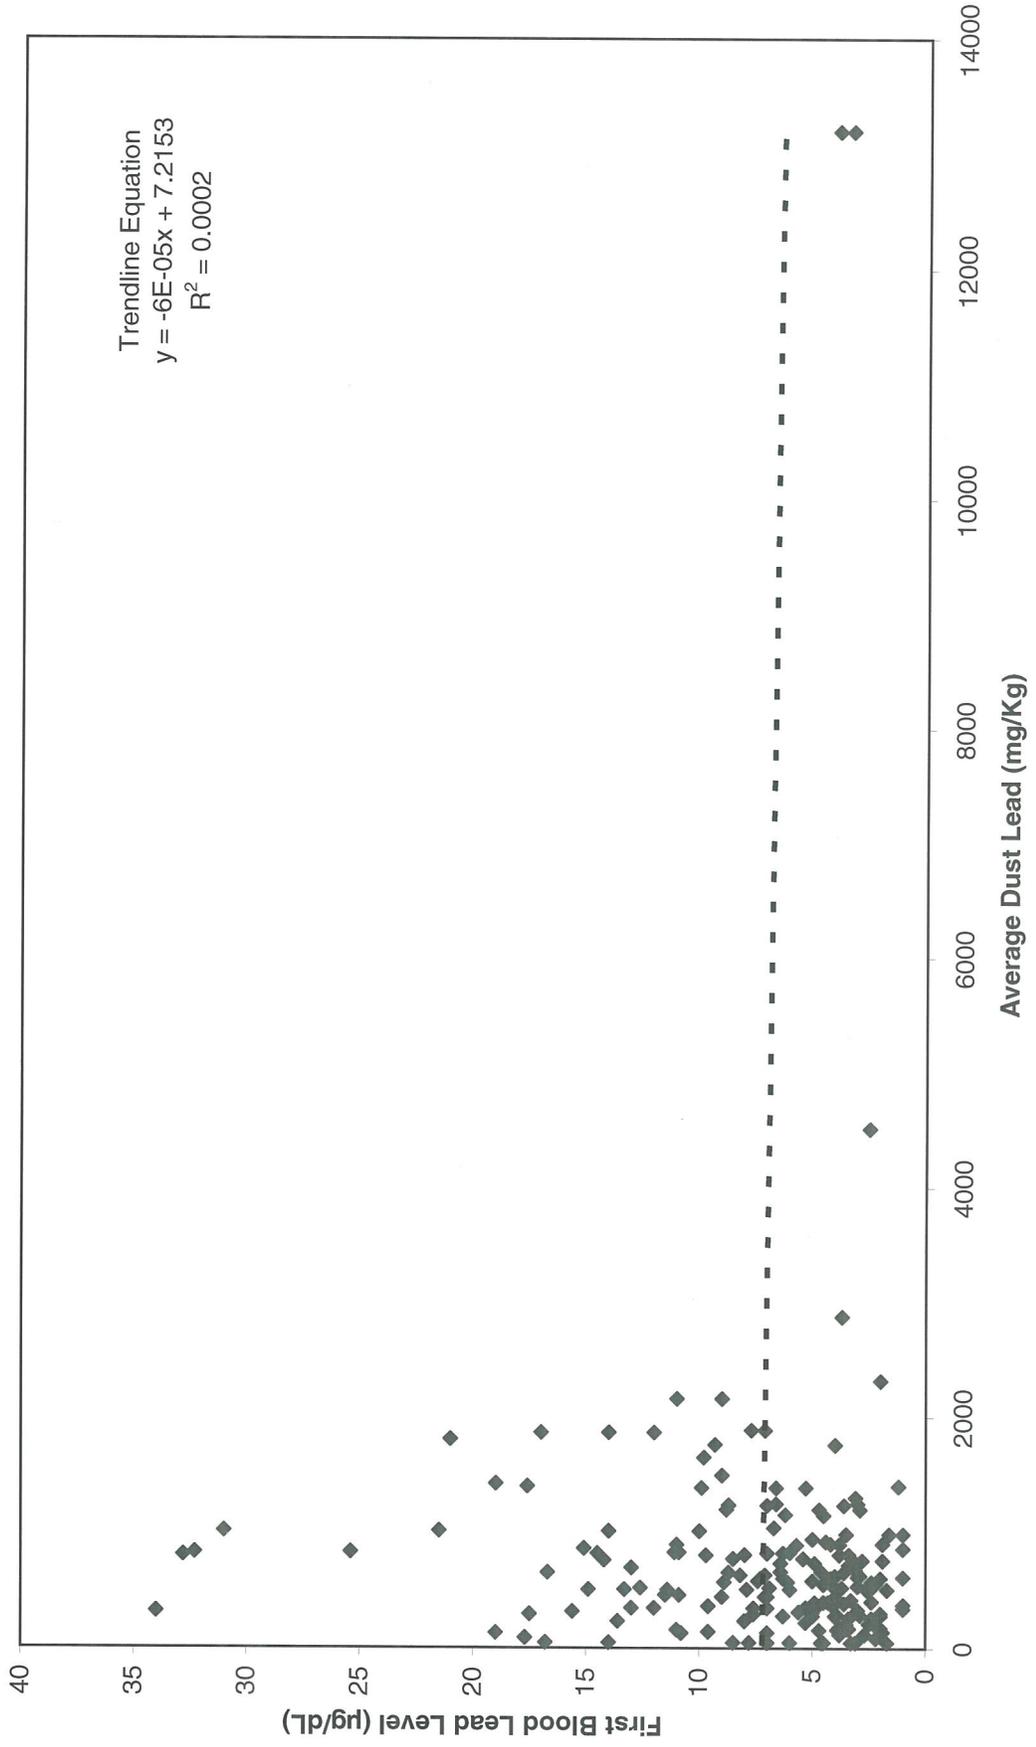


Figure 6-14. 1994-2005 - Sitewide - 30-second Flush Water Lead vs. First-test Blood Lead Level

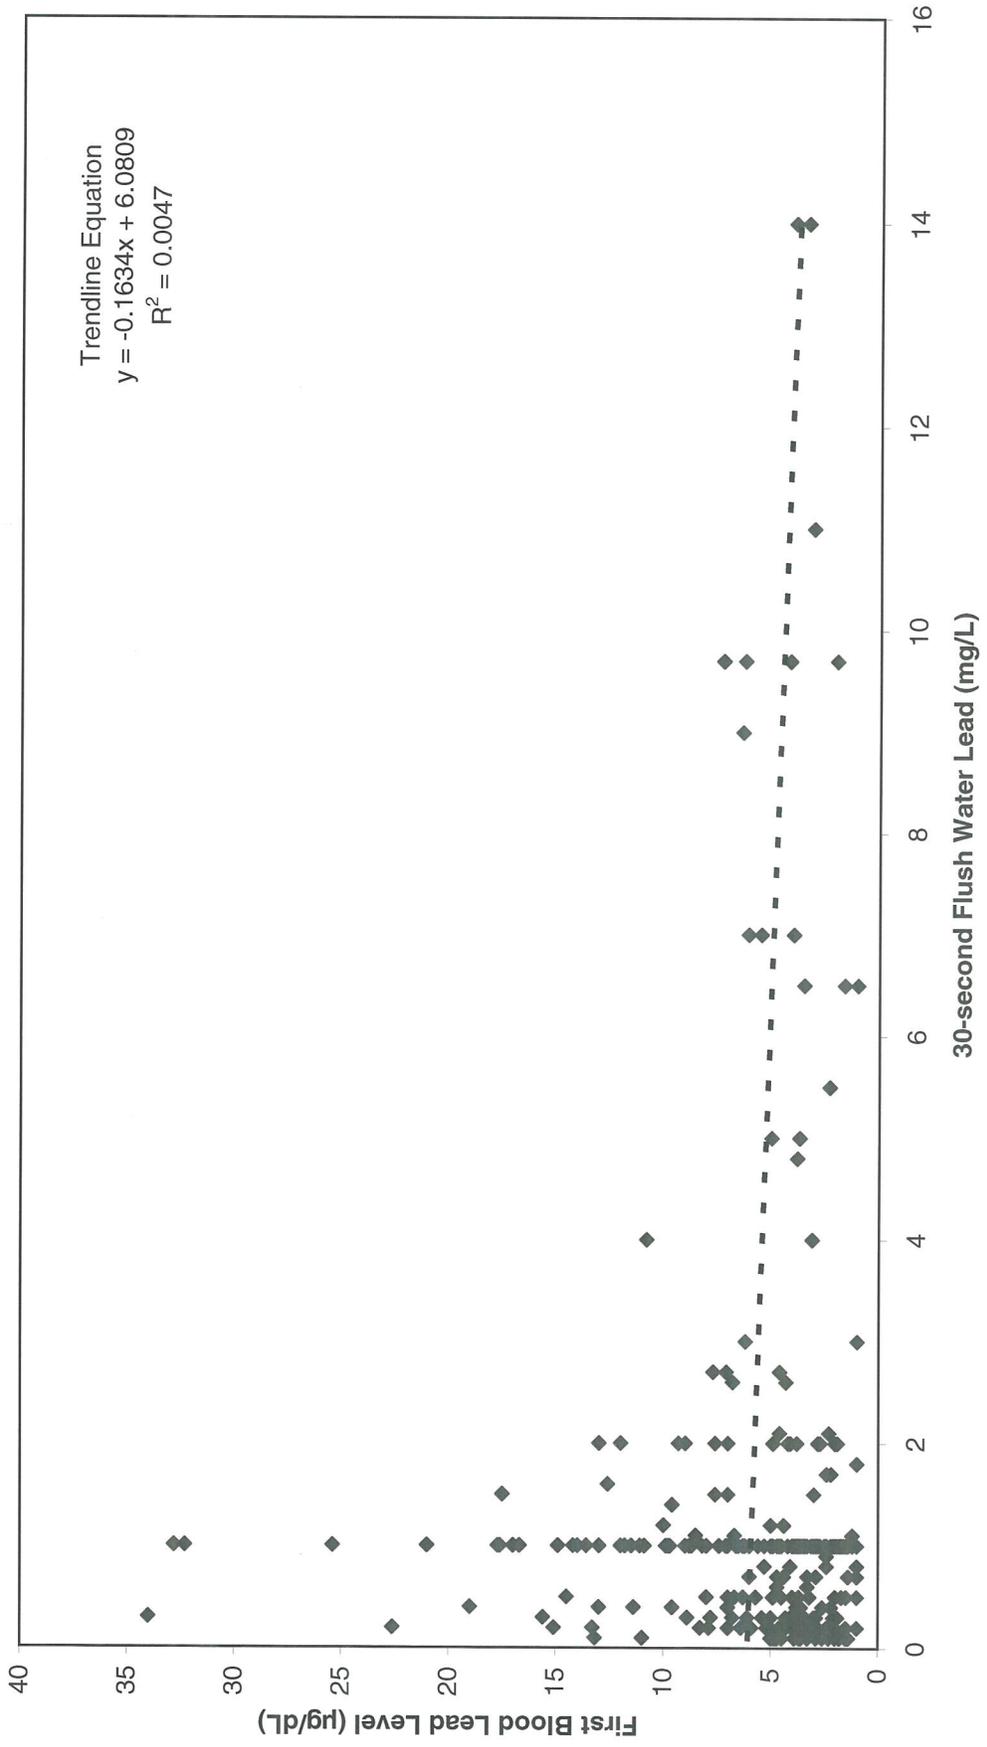


Figure 6-15. 1994-2005 - Sitewide - 6-8 hour Hold Water Lead vs. First-test Blood Lead Level

